


8.0000	CAL I (IN )	18.000	1.0000	VHXO ( )	0.0
8.0000	BS (IN )	18.000	1.0000	SH ( )	-1.000
2.5000	RHGF (G/C3)	3.0000	0.1000	RT (DHMM)	1000.0
0.0	MSI ( )	1.0000	0.1000	RT (DHMM)	1000.0
			1.0000	PHIE ( )	0.0

FILE

2

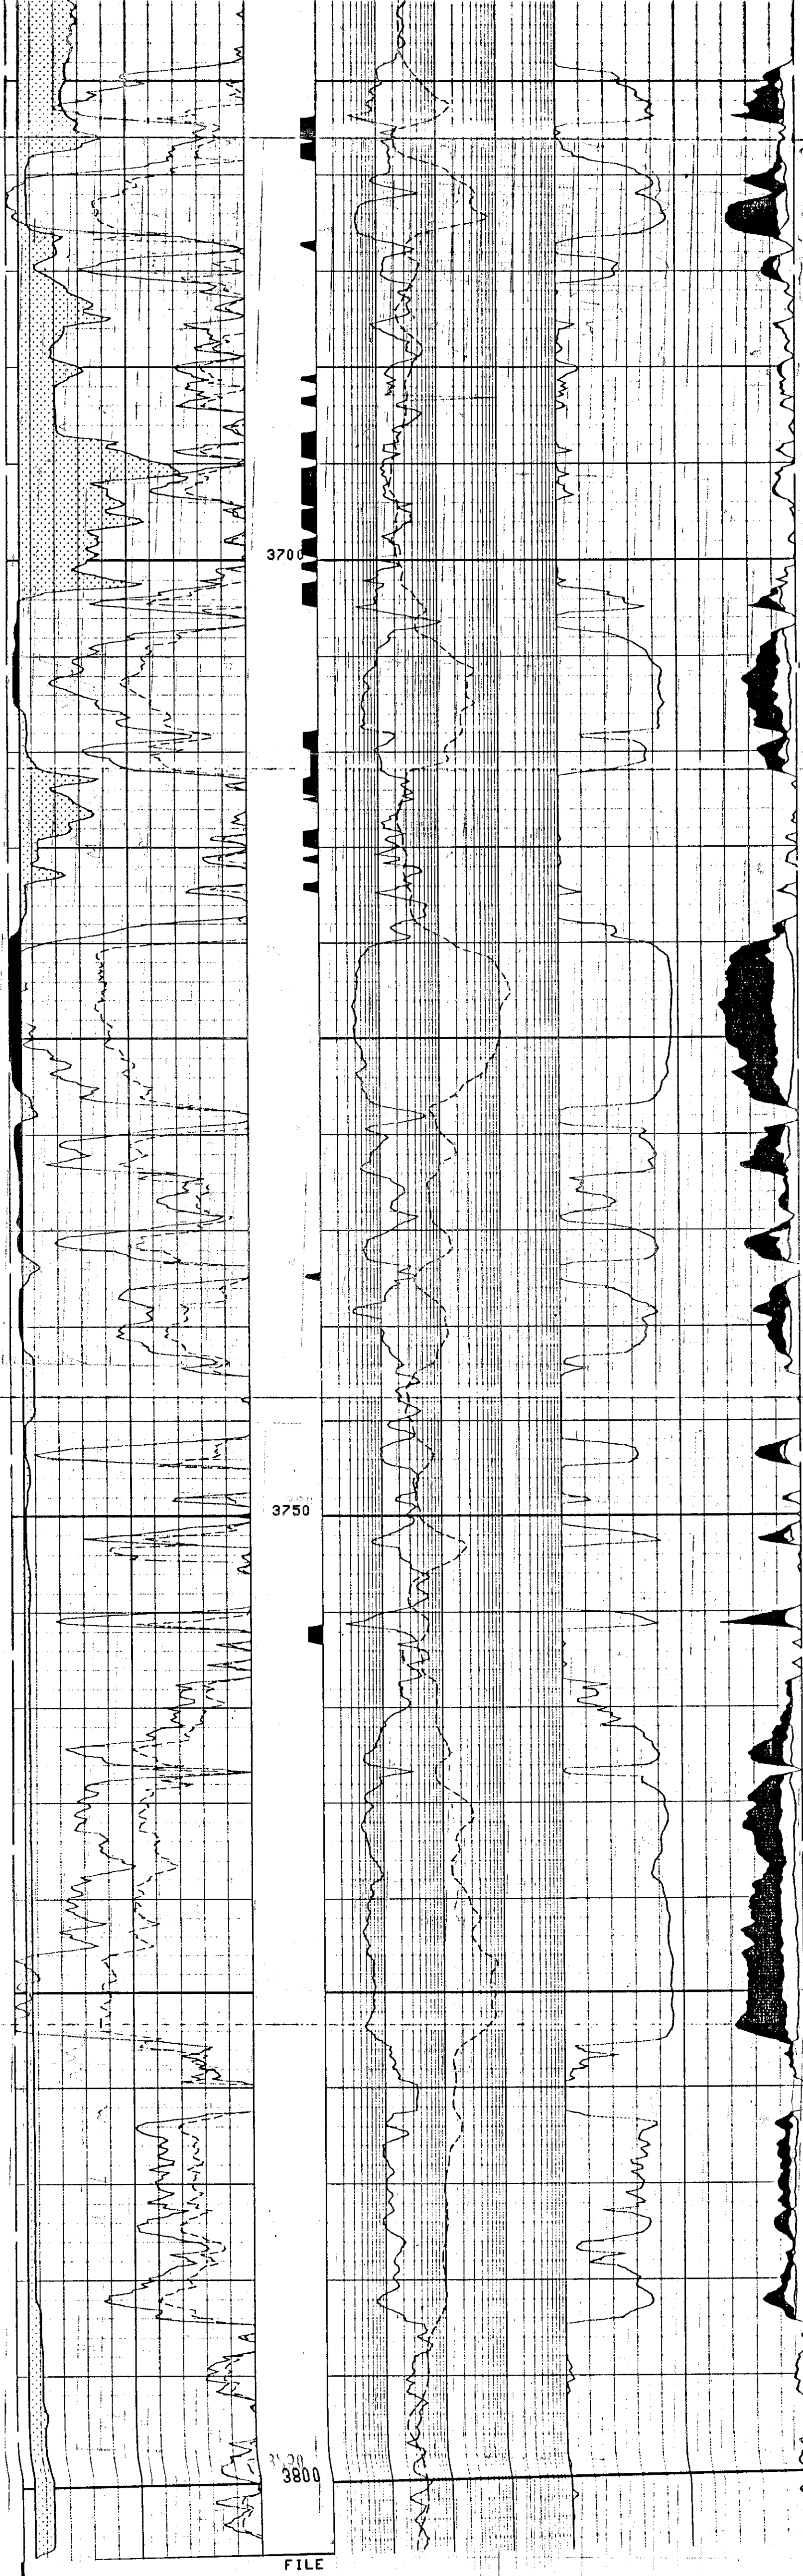

FILE

5

8.0000	CAL I (IN )	18.000	1.0000	VHXO ( )	0.0
8.0000	BS (IN )	18.000	1.0000	SH ( )	-1.000
2.5000	RHGF (G/C3)	3.0000	0.1000	RT (DHMM)	1000.0
0.0	MSI ( )	1.0000	0.1000	RT (DHMM)	1000.0
			1.0000	PHIE ( )	0.0


PARAMETERS

NAME	VALUE	UNIT	NAME	VALUE	UNIT
KEXP	1.00000		BS	8.50000	IN
KES	E4		KCDM	1.00000	
GRSS	GR		FRT	DISA	
UM23	4.77900		UM33	8.99700	
UM23	8.99700		UM31	13.7700	
UM21	13.7700		UM22	4.77900	
RG33	2.87700		UF	0.398000	
RG31	2.71000		RG32	2.64400	
RG22	2.64400		RG23	2.87700	
LDTA	ABSE		RG21	2.71000	
SDGC	DGCN		SIS	NONE	
TPML	9.80000		NMLA	ABSE	
DLLM	0.350000		GULM	999.000	GAPI
MDET	NEIT		NLIM	0.010000	
FRTC	NONE		LSHB	DISA	
GDCL	0.0	G/C3	GDSH	2.90000	G/C3
TPFM	7.20000	NS/M	DRUL	0.100000	G/C3
TPSM	7.20000	NS/M	TPDM	8.70000	NS/M
FEPT	NONE		FESX	DISA	
FCAL	PRES		POUT	LIME	
RHF	0.038000	DHMM	RHB	0.200000	DHMM
NPCL	0.0		NPSH	0.500000	
SPCL	-200.000	MV	SPSH	0.0	MV
GRCL	20.0000	GAPI	GRSH	90.0000	GAPI
NGSI	NEIT		PMAX	0.500000	
WMUD	15.6000	LB/G	SINP	GR	
SDNI	PRES		RXOF	PRES	
RTLF	DISA		BHT	260.000	DEGF
HC	CALI		RMF	0.060000	
FD	1.05000	G/C3	MATR	LIME	
CDTS	100.000		MDEN	2.68000	G/C3
DTF	189.000	US/F	DTM	56.0000	US/F
DO	0.500000	F	BHS	DPEH	

8.0000	CAL I (IN )	18.000	0.9000	SPHI ( )	-0.100
8.0000	BS (IN )	18.000	0.0100	RMFA (DHMM)	100.00
2.5000	RHGA (G/C3)	3.0000	0.0100	RFA (DHMM)	100.00
0.0	GR (GAPI)	150.00	0.1000	RT (DHMM)	1000.0
				0.9000	PHIA ( )
				0.9000	DPHI ( )
				0.9000	NPHI ( )

FILE

5

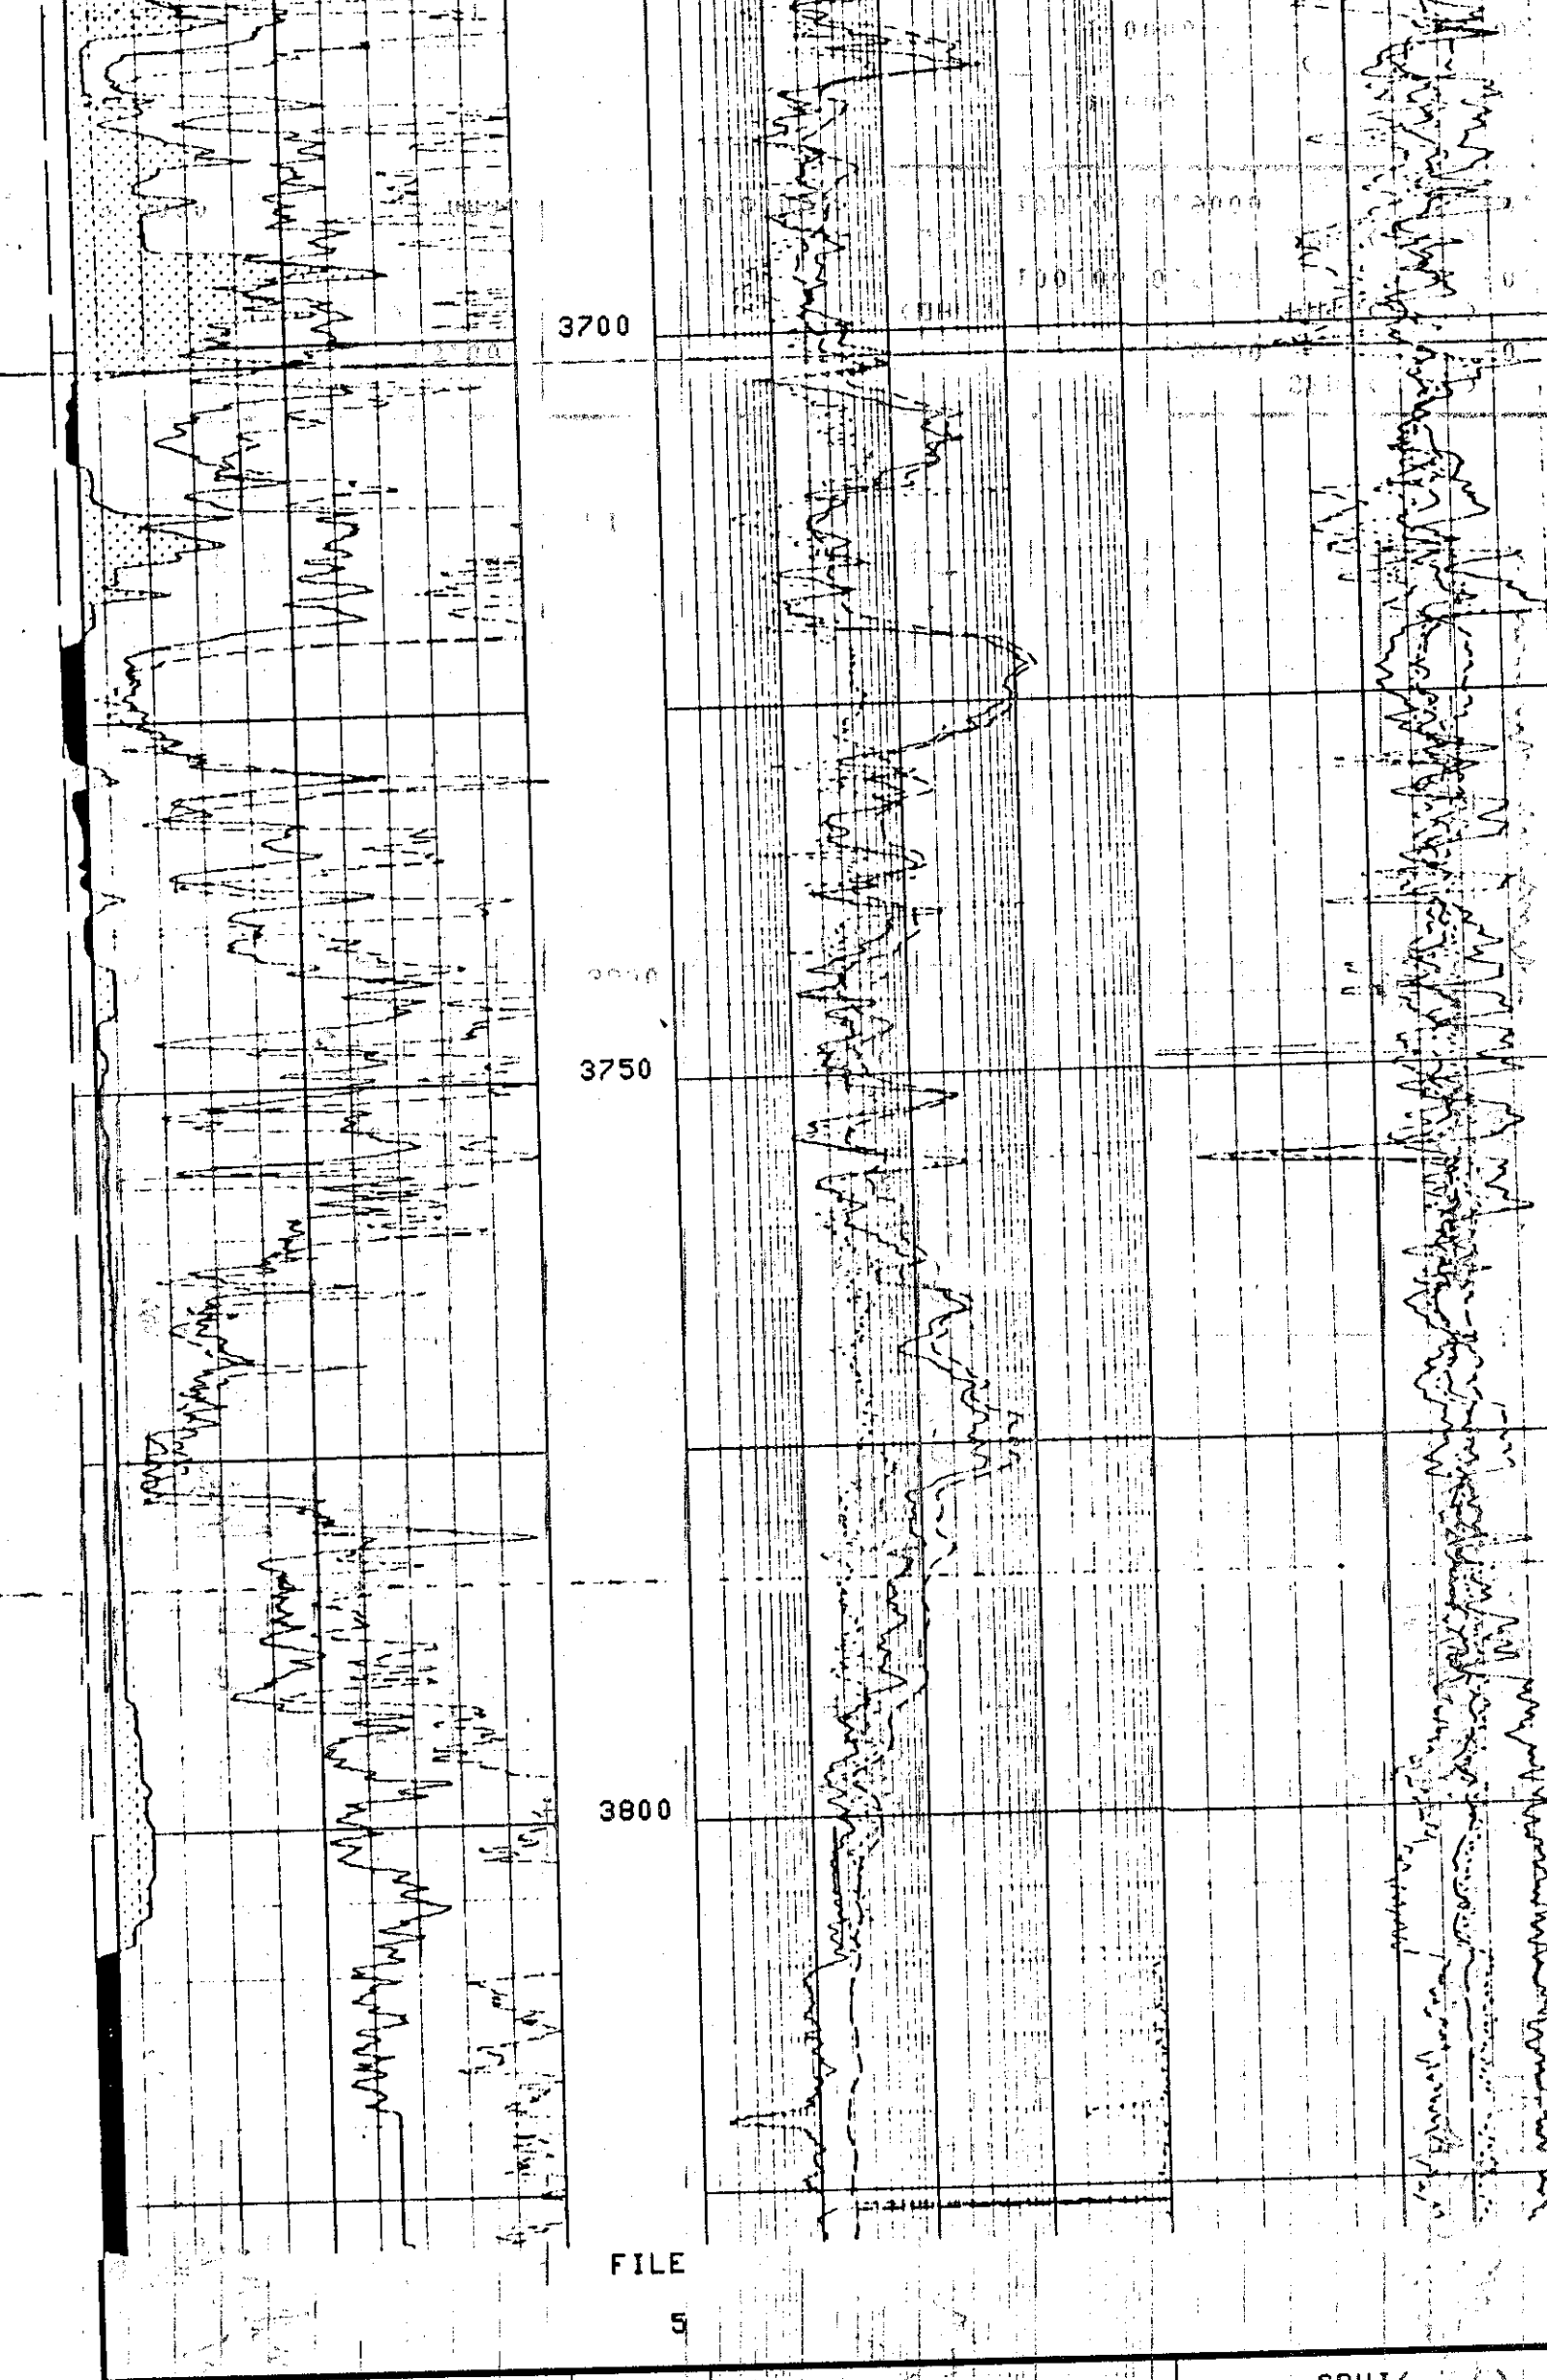

FILE

5

8.0000	CAL I (IN )	18.000	0.9000	SPHI ( )	-0.100
8.0000	BS (IN )	18.000	0.0100	RMFA (DHMM)	100.00
2.5000	RHGA (G/C3)	3.0000	0.0100	RFA (DHMM)	100.00
0.0	GR (GAPI)	150.00	0.1000	RT (DHMM)	1000.0
				0.9000	PHIA ( )
				0.9000	DPHI ( )
				0.9000	NPHI ( )

PARAMETERS

NAME	VALUE	UNIT	NAME	VALUE	UNIT
KEXP	1.00000		BS	8.50000	IN
KES	E4		KCDM	1.00000	
GRSS	GR		FRT	DISA	
UM23	4.77900		UM33	8.99700	
UM23	8.99700		UM31	13.7700	
UM21	13.7700		UM22	4.77900	
RG33	2.87700		UF	0.398000	
RG31	2.71000		RG32	2.64400	
RG22	2.64400		RG23	2.87700	
LDTA	ABSE		RG21	2.71000	
SDGC	DGCN		SIS	NONE	
TPML	9.80000		NMLA	ABSE	
DLLM	0.350000		GULM	999.000	GAPI
MDET	NEIT		NLIM	0.010000	
FRTC	NONE		LSHB	ALLO	
GDCL	0.0	G/C3	GDSH	2.90000	G/C3
TPFM	7.20000	NS/M	DRUL	0.150000	G/C3
TPSM	7.20000	NS/M	TPDM	8.70000	NS/M
FEPT	NONE		FESX	DISA	
FCAL	PRES		POUT	LIME	
RHF	0.045000	DHMM	RHB	0.150000	DHMM
NPCL	0.0		NPSH	0.500000	
SPCL	-200.000	MV	SPSH	0.0	MV
GRCL	20.0000	GAPI	GRSH	90.0000	GAPI
NGSI	NEIT		PMAX	0.500000	
WMUD	15.6000	LB/G	SINP	GR	
SDNI	PRES		RXOF	PRES	
RTLF	DISA		BHT	260.000	DEGF
HC	CALI		RMF	0.055000	
FD	1.05000	G/C3	MATR	LIME	
CDTS	100.000		MDEN	2.68000	G/C3
DTF	189.000	US/F	DTM	56.0000	US/F
DO	0.500000	F	BHS	DPEH	